

# BLS 12/24C BATTERY TEST BANK

---

**String Name:** TEST BANK 1  
**Battery Name:** FIAMM TEST BANK  
**Location Name:** BLS 12 24C  
**Model Number:** FIAMM 12VDC 80AH  
**Number of Cells:** 6  
**Install Date:** 05/09/2013  
**Read Date:** 05/19/2012

**Threshold:**

- High Cell Voltage: 2.900
- Low Cell Voltage: 1.500
- High Cell Resistance: 2000
- Low Cell Resistance: 1000
- Intercell Resistance 1: 10000
- Intercell Resistance 2: 10000
- Intercell Resistance 3: 10000
- Intercell Resistance 4: 10000
- High Temperature: 82.0
- Low Temperature: 62.0
- High Specific Gravity: 0.000
- Low Specific Gravity: 0.000

**Temperature Units:** F  
**Charger Frequency:** 60 Hz

# BLS 12/24C BATTERY TEST BANK

String Name: TEST BANK 1

Read Date: 05/19/2012

---

<u>Cell #</u>	<u>Voltage</u>	<u>Internal Res</u>
1	2.287	4656
2	2.291	5916
3	2.199	9928
4	2.284	4177
5	2.284	4938
6	2.274	7765

# BLS 12/24C BATTERY TEST BANK


String Name: TEST BANK 1

Read Date: 05/19/2012

**Summary:**

	<u>Voltage</u>	<u>Internal Res</u>
<u>High</u>	2.291	9928
<u>Avg</u>	2.270	6230
<u>Low</u>	2.199	4177

**Overall Voltage:** 13.6

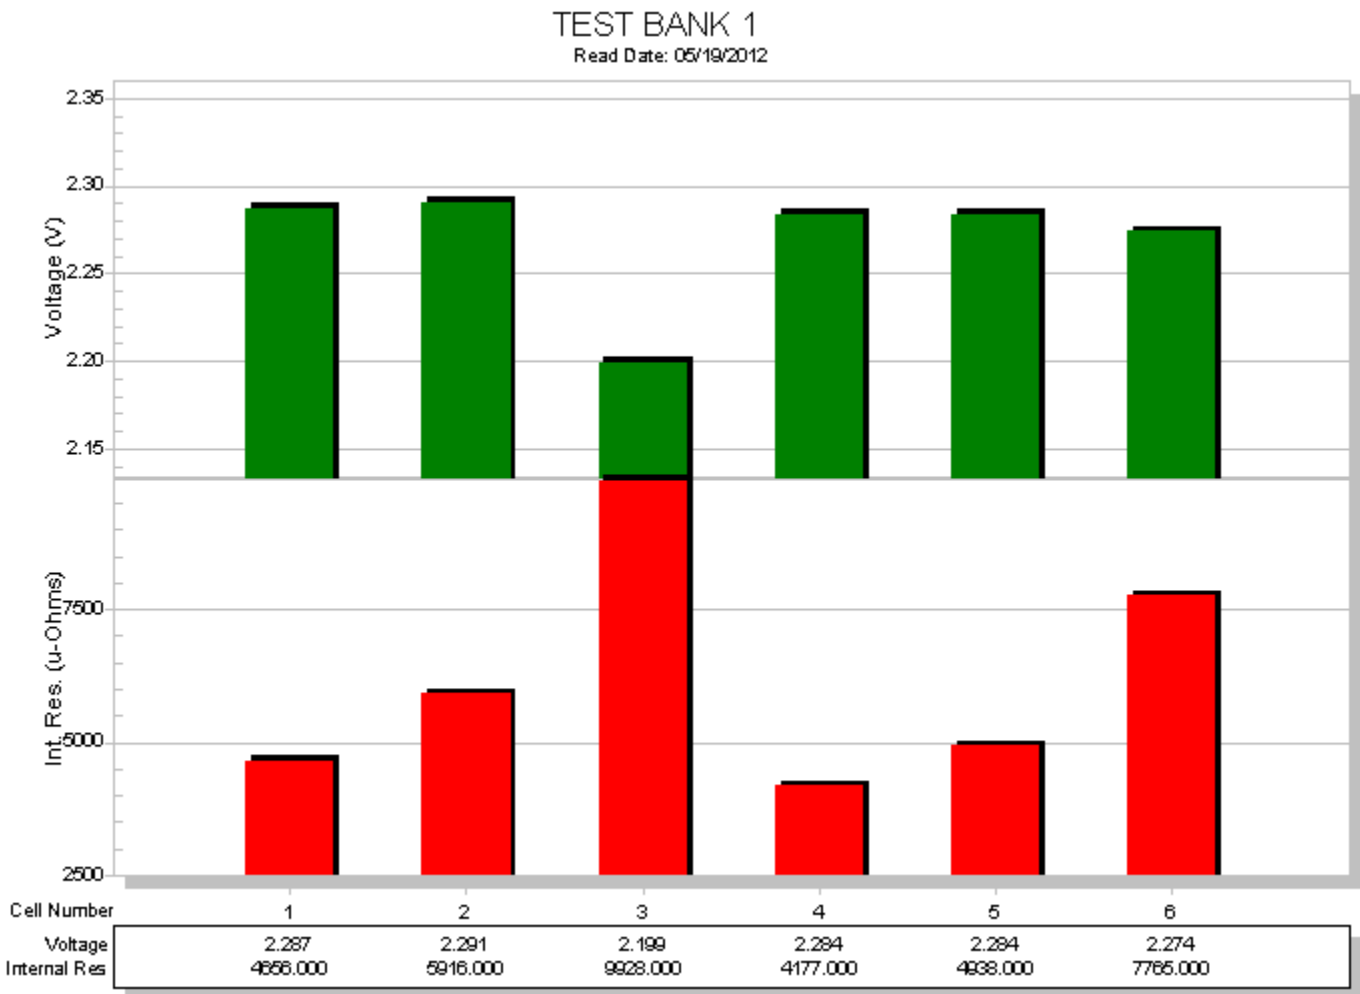

**Comments:**

# BLS 12/24C BATTERY TEST BANK

String Name: TEST BANK 1

Read Date: 05/19/2012

---

05/20/2013

READINGS INDICATE CLEARLY THAT CELL# 3 INTERNAL RESISITANCE HAS DESCREASED FROM 19680 TO 9940. VOLTAGE READINGS WILL BE COMPARED PRIOR TO DISCHARGE AND RESISTANCE AFTER 6 MORE CYCLES.